

:hager

6LE090983Aa – CO 155366




ASxxxxT - ASxxxxU
RCBO 3P+N 6 & 10kA in 3M
C &D Curve
Type A
Switched neutral

3P+N RCBO

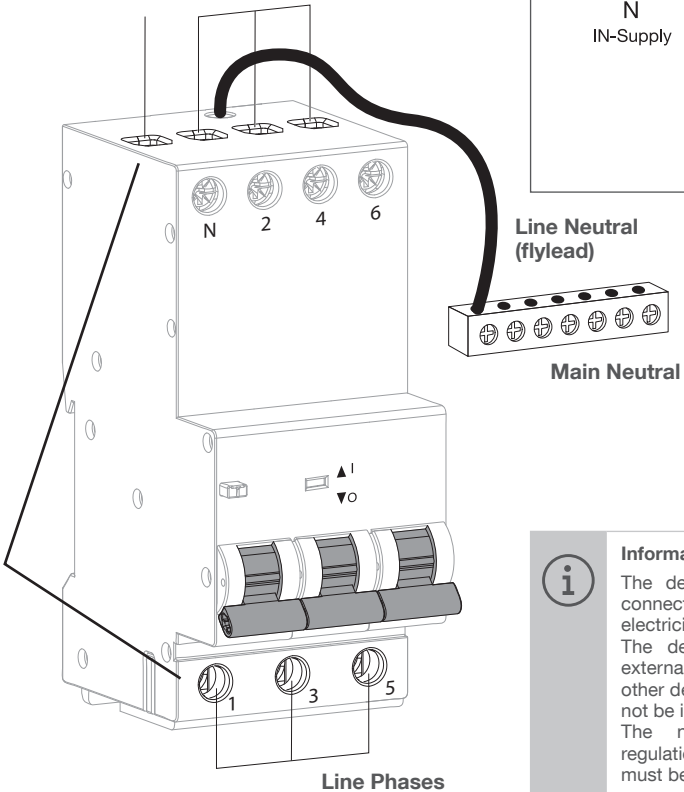

Device wiring diagram

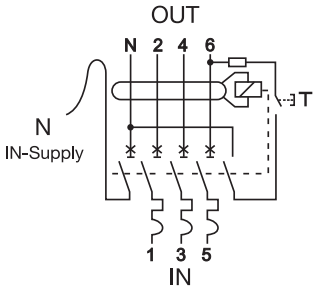


	rigid	stranded
(mm²) Cu	1 - 25 mm²	
	12 / 15 mm	
	PZ2	
	2,5 Nm	
	Terminal size for cables : 25 mm² (up to 63 A)	

Information

The device may only be installed, connected and serviced by a qualified electrician.
The device must be checked for external damage. If any damage or other defect is found, the device must not be installed.
The national regulations, safety regulations and installation standards must be observed.


Danger !

Electric shock when touching live parts!
Electric shock can lead to death!
Before working on the unit, disconnect the connecting cables and cover live parts in the vicinity!

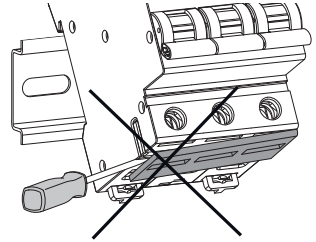



DO NOT REMOVE THIS PIECE

Line connection via Hager Invicta and Performa panelboard chassis, forked busbar or cable.

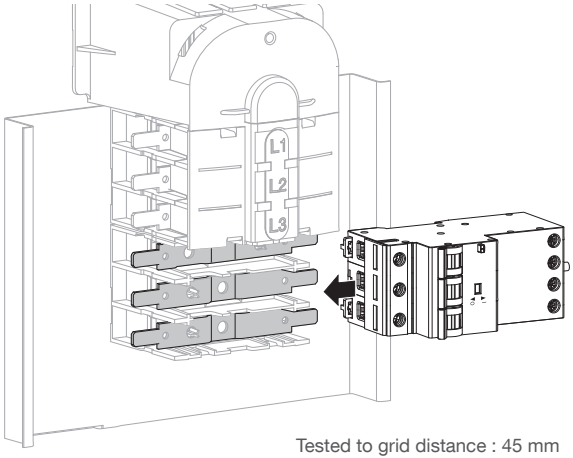


Tested to grid distance : 45 mm





Longbody type RCBO may not be compatible with all DIN enclosures.

Testing every 3 months

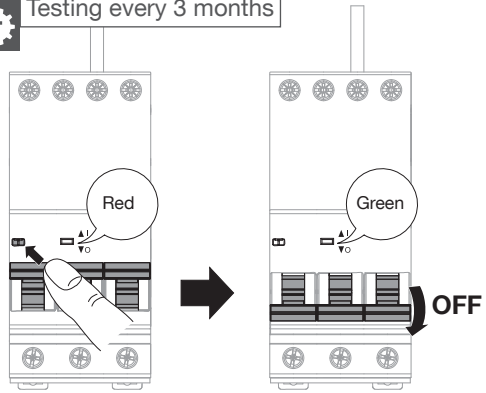

Switch Off and disconnect load side L & N before dielectric test.

Hager recommends testing every RCBO both after installation and during service regularly by pushing the Blue RCD test button marked with a 'T'.

